


PDUtest: dev-1



电压



电流



功率



频率



电量

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0



1

2

3

4

5

6

7

8



首页



控制




信息









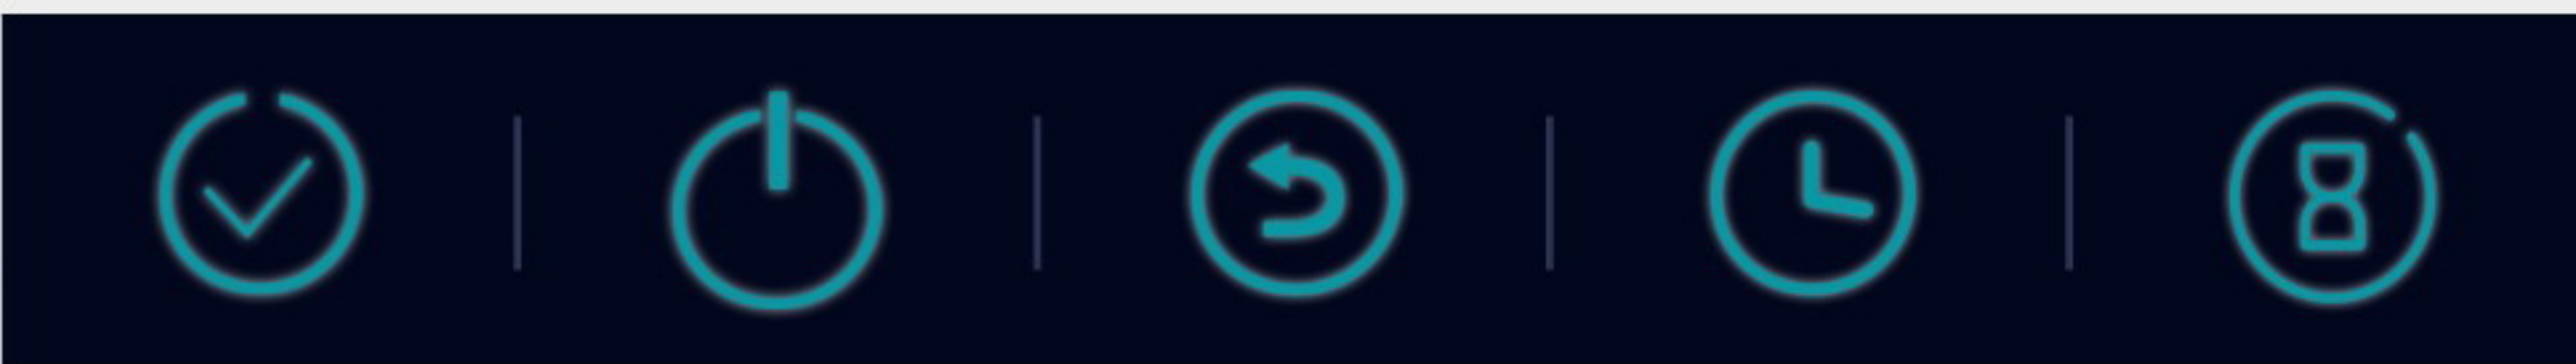






触发器





维护



- ⏻
- 1
- 2
- 3
- S
- I
- 手动控制座控制
- A
-
- 1
- 2
- 3

1		空调	<input checked="" type="checkbox"/>	
2		无线热点	<input checked="" type="checkbox"/>	
3		摄像机	<input checked="" type="checkbox"/>	
4		电风扇	<input checked="" type="checkbox"/>	
5		防火墙	<input checked="" type="checkbox"/>	
6		灯	<input checked="" type="checkbox"/>	
7		NAS	<input checked="" type="checkbox"/>	
8		打印机	<input checked="" type="checkbox"/>	

PDUtest: dev-1



电压



电流



触发器总览

电压触发

电流触发

电量触发

温度触发

定时触发

网络连接触发

IO触发器

0.0



1

0.0



8


PDUtest: dev-1



电压



电流

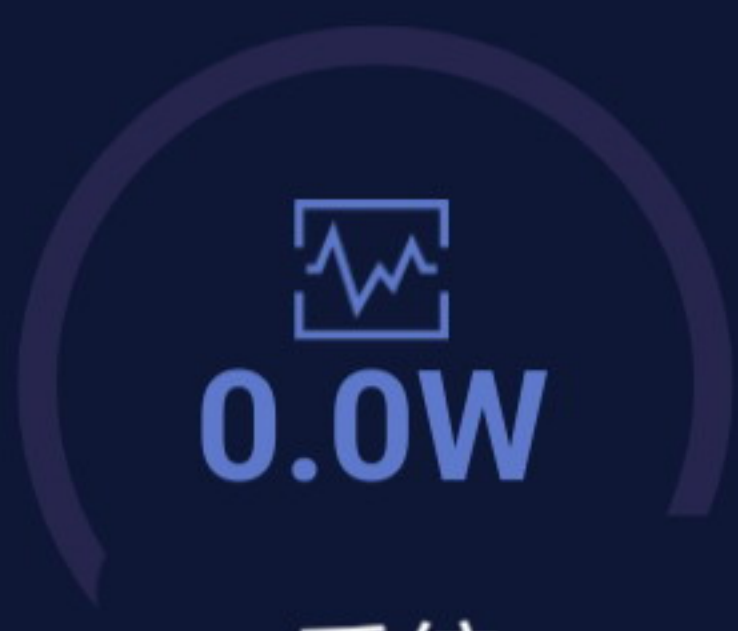

系统



时间

网络

管理密码

服务

设备单元

固件升级

恢复出厂设置

设备重启

0.0



1

0.0



8



1

1



空调



2

2



无线热点



3

3



摄像机



A

4



电风扇



5



防火墙



6



灯



7

操作日志

报警日志

关于设备



首页



控制



信息



触发器



维护

插座控制